



TYPICAL (GRAVITY) SIDE SEWER CONNECTION

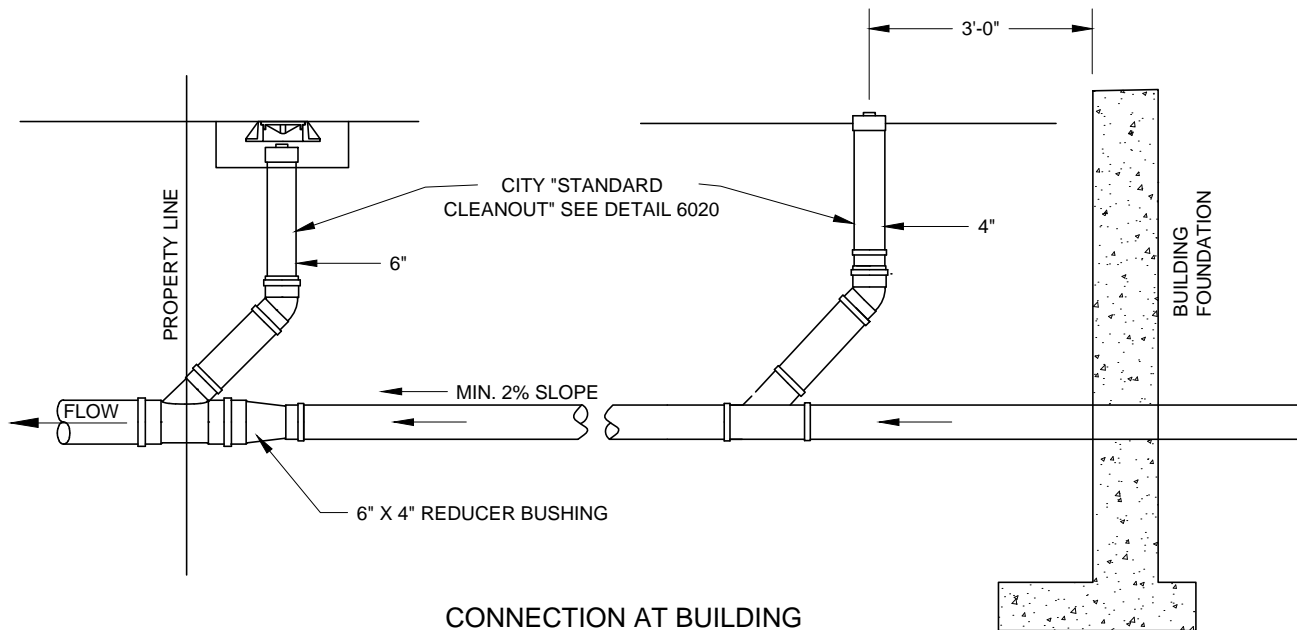

CONNECTION AT BUILDING

NOTES:

1. SIDE SEWER CONNECTION TO AN EXISTING MAIN SHALL BE MADE BY CORE DRILLING THE EXISTING PIPE AND INSTALLING AN INSERT-A-TEE ADAPTOR.
2. A SIDE SEWER CONSTRUCTED AS PART OF A MAIN INSTALLATION SHALL BE INSTALLED WITH A WYE FITTING AND A 45° BEND.
3. EXISTING GRADES MAY REQUIRE A BACKWATER VALVE. SEE BMC 15.03.120

 <p>City of Bremerton</p> <p>PUBLIC WORKS</p> <p>DESIGN/CONSTRUCTION STANDARDS</p>	<p>SIDE SEWER INSTALLATION</p> <p>(GRAVITY)</p> <p><small>Alteration of this drawing is prohibited. Any approval of an altered drawing is unauthorized and void.</small></p>	<p>6040</p> <p>Revision Date 9/23/14</p>
---	--	---